[illegible]

**FARRIS ENGINEERING
CONSULTING ENGINEERS**
•OMAHA, NE.
•COLORADO SPRINGS, CO.
•LINCOLN, NE.
•DES MOINES, IA

COPYRIGHT
This document and the information contained
may not be reproduced or excerpted from
this publication without the prior written
consent of Farris Engineering, Inc. Unauthorized
copying, disclosure or construction use are
prohibited by the copyright law.

PE # 07763

IMPORTANT CONTRACTOR'S NOTE

1. ALL CONTRACTORS ARE RESPONSIBLE FOR REVIEWING ENTIRE SET OF DOCUMENTS TO DETERMINE THEIR FULL SCOPE OF WORK. CONTRACTOR SHALL NOT BE ALLOWED EXTRA COSTS DUE TO FAILURE TO REVIEW ENTIRE SET OF DOCUMENTS OF PROJECT.
2. THE FINISHED DOCUMENTS ARE DONE SO AT THE CONTRACTORS RISK.

CH
Calvin L. Hinz
A R G U M E N T F O R

--

Calvin L. Hinz Architects, P.C. CH 2007-37
 3706 North 20th Street
 Elkhorn, Nebraska 68022
 Phone: 402.291.6941, Fax: 402.291.9193

Parits Engineering
 11239 Chicago Circle
 Omaha, Nebraska 68154
 402.530.9900 402.530.9902

United Engineering
 20007 Nicolares Circle, Suite 108
 Omaha, Nebraska 68134
 402.763.9475 402.763.9567


Kenneth D. Iatsum & Associates, P.C.
1901 N. 81st Street
Omaha, Nebraska 68114
402/391-5801

BASEMENT	
FIRE SPRINKLER FLOOR PLAN	
Construction Documents (002) Submit	
Approved _____	Date: _____
Approved _____	Date: _____
Approved _____	Date: _____

BUILDING SIX RENOVATION/ ADDITION		
VAMC Omaha, NE		
Date	Checked by	Drawn by
FEBRUARY 20, 2009		

Project Number: Phase 2 and 4 of 636-07-134	Building Number: SIX	Drawing Number: F1.0	Dwg. 22 of 37
--	----------------------	--------------------------------	---------------

**Office of
Construction
and Facilities
Management**

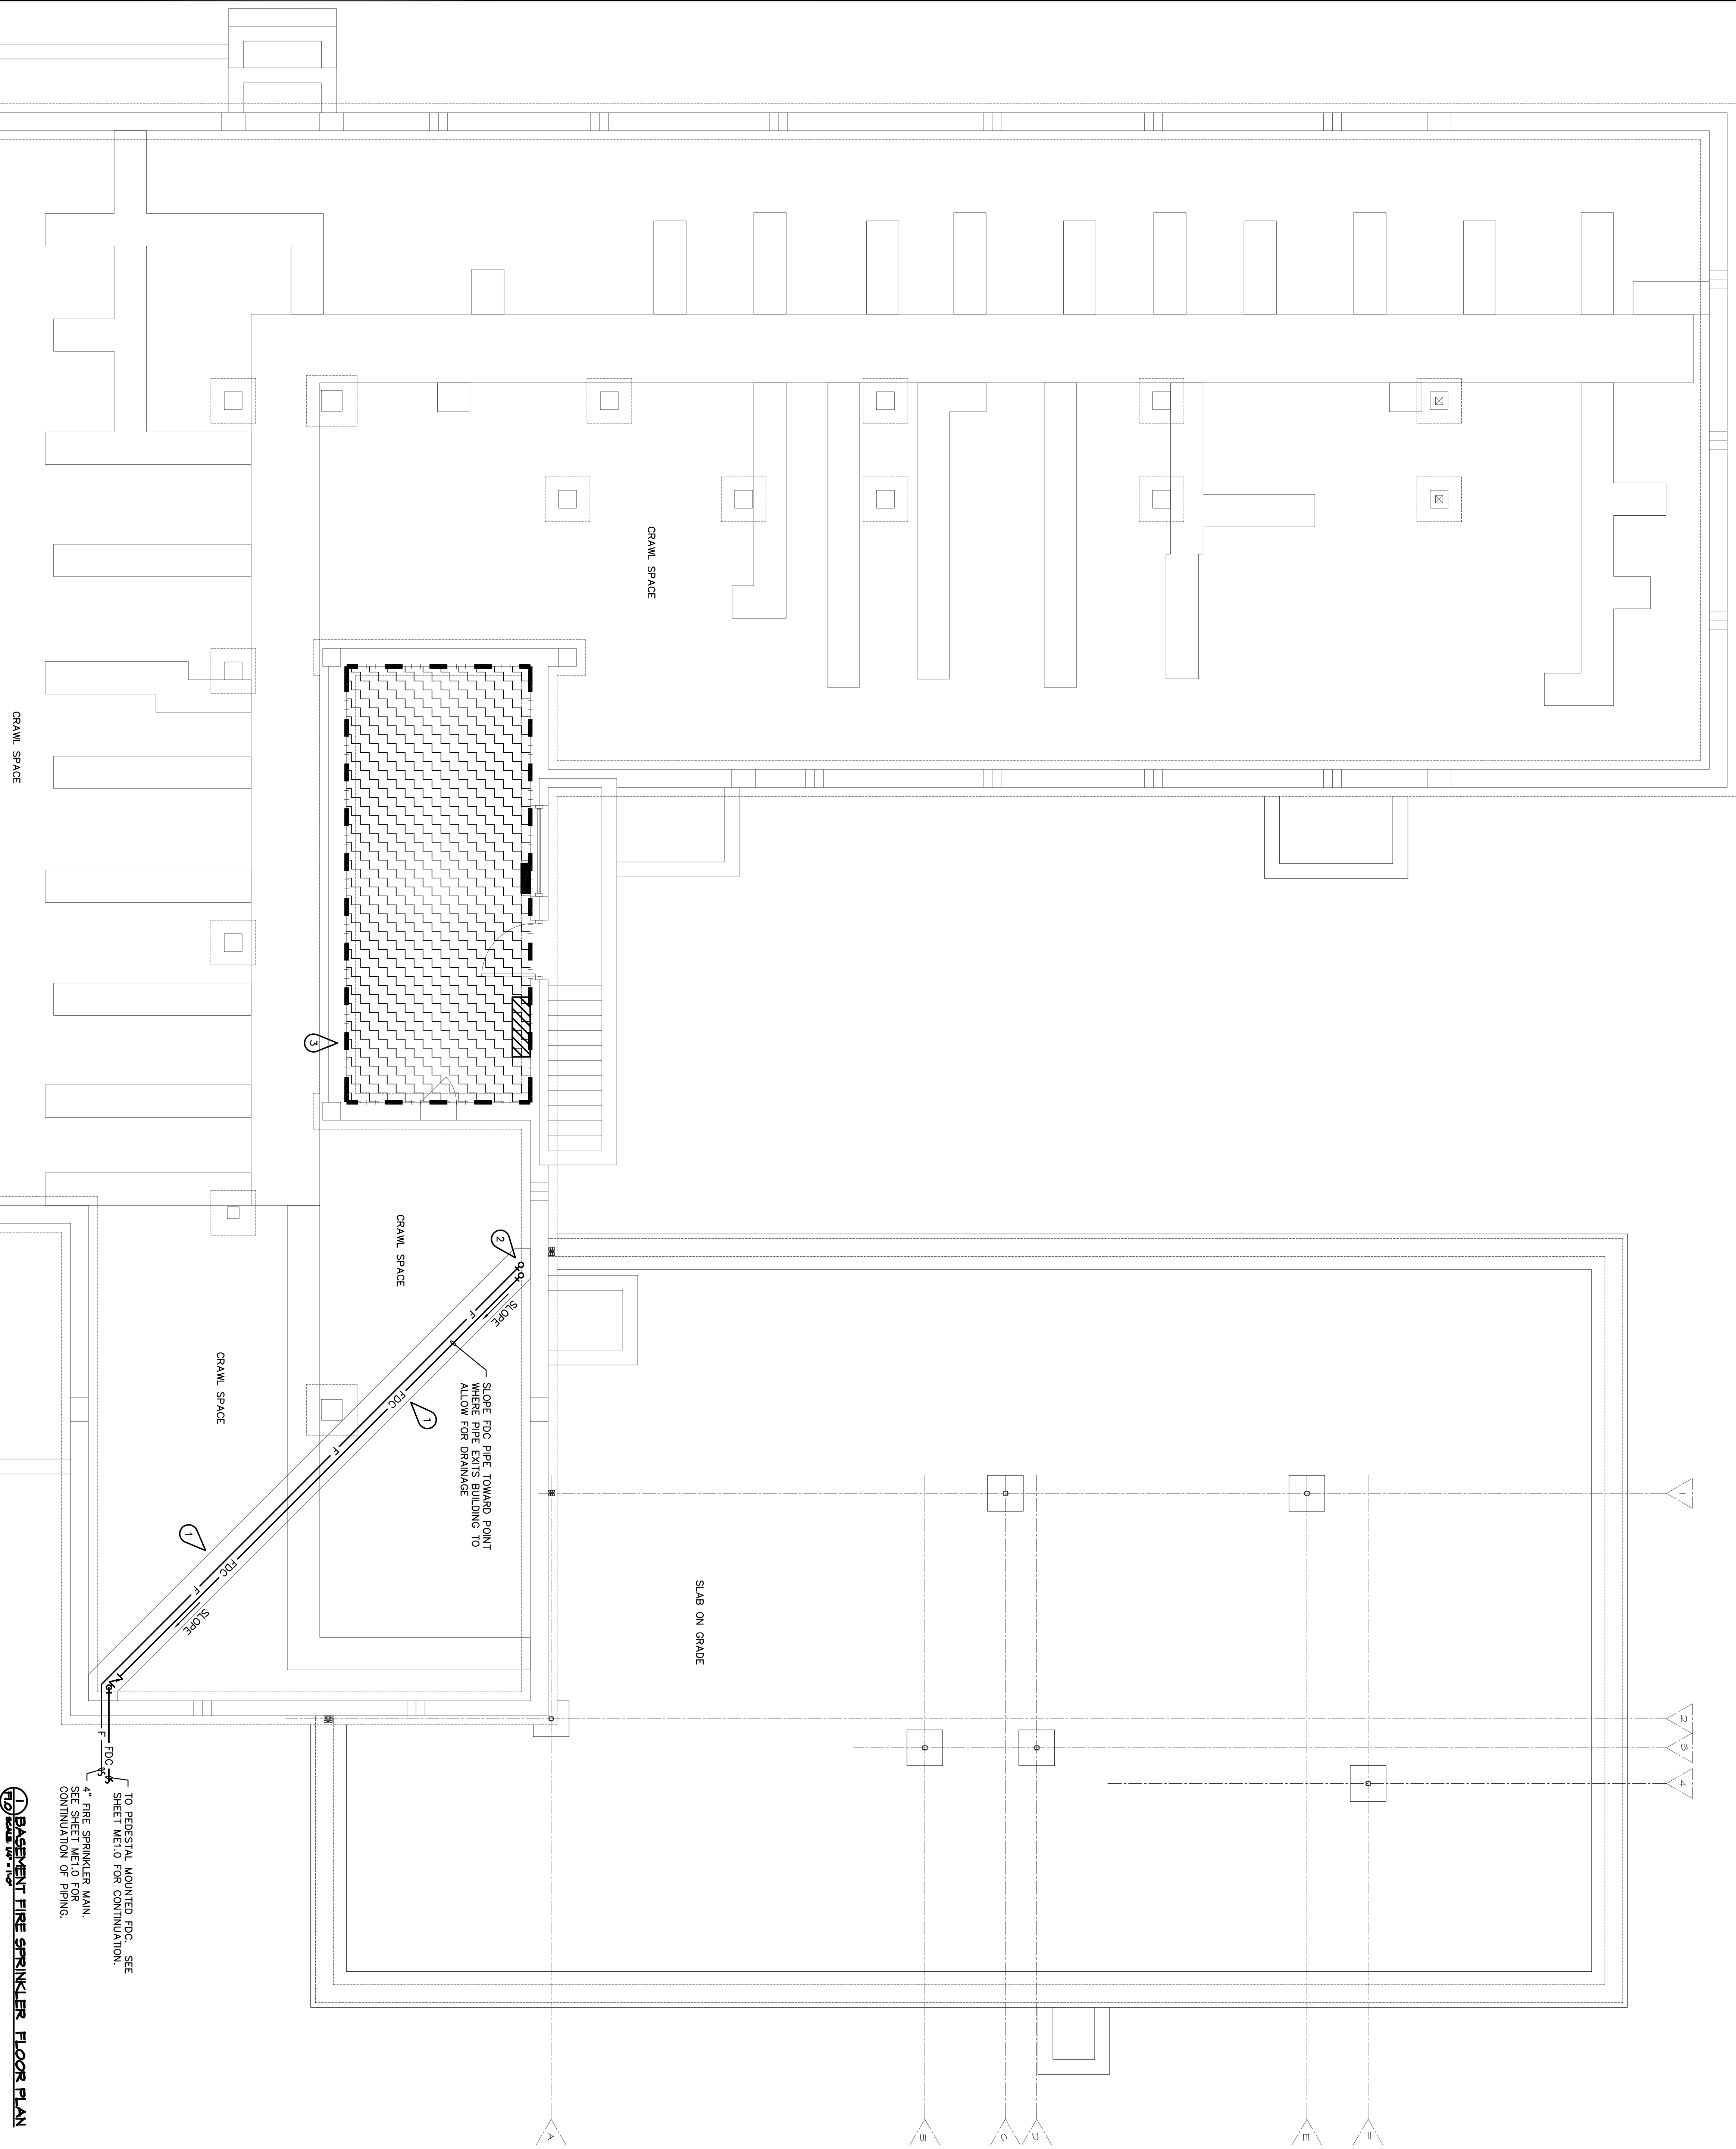

MECHANICAL KEYNOTES: (\bigcirc)

- 1 ROUTE NEW 4" FIRE SPRINKLER MAIN IN NEW PIPED AS SHOWN ON PLANS.
- 2 ROUTE FIRE MAIN UP TO FIRST FLOOR PIPE CHASE. FIELD VERIFY EXACT LOCATION OF CHASE.
- 3 EXISTING BASEMENT IS PRIMARILY GRAUL SPACE NOT USED FOR STORAGE AND NOT REQUIRING SPRINKLER PROTECTION. PROTECT EXISTING MECHANICAL ROOM WITH SPRINKLERS. INTERMEDIATE TEMPERATURE (225°F) RATED SPRINKLERS OR HIGHER RATED IF FIELD SURETY OF EXISTING EQUIPMENT DETERMINES HIGHER TEMPERATURE RATED SPRINKLERS ARE WARRANTED.